


**NOTE:**

1. MINIMUM SLOPE IS 2:12.
2. THE FOLLOWING APPLIES FOR MA SYSTEMS ONLY: FOR INSULATION THICKNESSES GREATER THAN 8", CONTACT INTERNATIONAL TPO CONTRACTOR SERVICES FOR ALTERNATE ATTACHMENT REQUIREMENTS. THESE METHODS MAY INCLUDE THE USE OF A HARD BOARD COVERING THE ASSEMBLY.
3. APPLY INTERNATIONAL TPO CUT EDGE SEALANT TO ALL CUT REINFORCED TPO EDGES.

**INTERNATIONAL TPO**

**TERMINATION AT SLOPED ROOF**

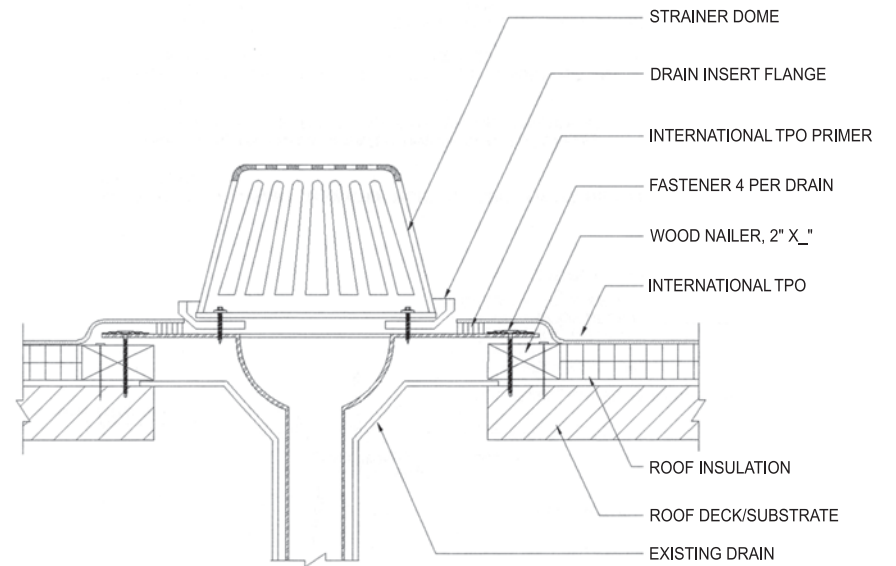

**NOTE:**

1. SHOULD BE USED WHERE ANY ROOF SUMP IS NO GREATER THAN 1/4" IN 12".

**INTERNATIONAL TPO**

**ROOF DRAIN INSERT FLASHING**